



INSTALLATION OF CERAMIC HEATERS


XD18 from n° 1 to 12 h : 2,45 m l : 35°



**PRELIMINARY
PROJECT**

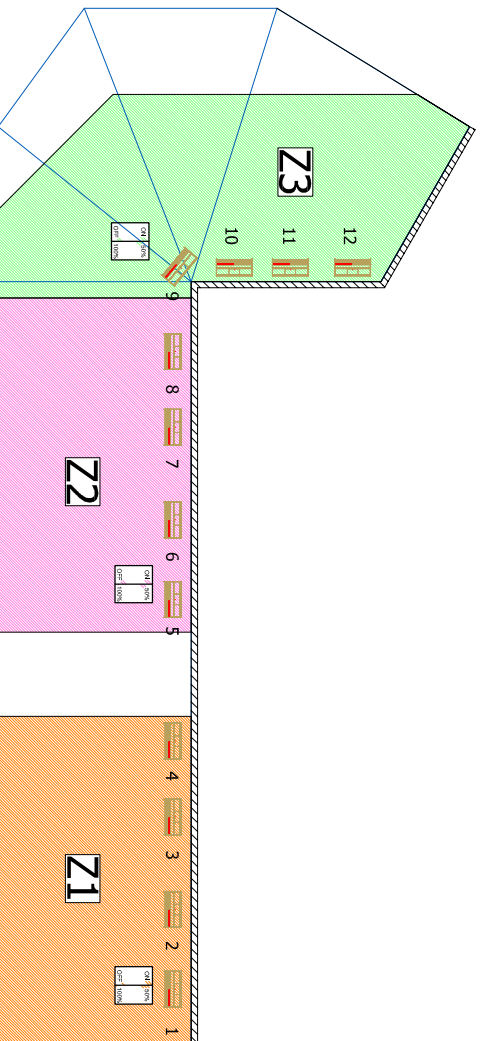

PART TIME HEATING - TEMPERATURE NOT GUARANTEED



INDEX	DATE	REVISION

- THIS HEATING SYSTEM MUST BE INSTALLED IN ACCORDANCE WITH APPLICABLE RULES AND REGULATIONS, AND IN WELL VENTILATED PREMISES

SOCIETE
BOURGUIGNONNE DE
MECANIQUE



SBM 21400 CLAVY
TEL : (433) 34074744
FAX : (433) 34074749

PUBLIC BAR

SURVEY N° **F18038**

HEATING BY CERAMIC HEATERS WITH THERMOSTATIC REGULATION

GAS : G20

CAPACITY INSTALLED (h) : 43,6 kW

GAS INLET PRESSURE AT HEATER : 20 mbar POWER SUPPLY : 230V single phase

DELIVERY PRESSURE AT POINT : 25 mbar

SCALE : 1/50

DATE : 28/09/2014 DRAWN BY : OEBELIN